
EKELR-30 Earth Leakage Relay User's Guide



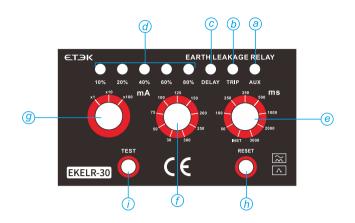

- a- Auxiliary power supply
- b- Trip status indicator
- c- Trip start indicator
- d- Leakage current indicator
- e- Time delay selector
- f- Sensitivity selector
- g- Sensitivity multiplier switch
- h Reset button
- i-Test button

Light Indicators

(i) Status indicators

Indicator			Status
AUX @	TRIP(b)	DELAY©	Status
Off	Off	Off	No auxiliary power
On	Off	Off	System normal, no tripping
On	Off	On	Trip start, time delay countdown started
On	On	Off	Earth leakage tripped

(ii) Leakage Indicators@

- a) The earth leakage indicators indicate the amount of leakage current detected and are expressed as percentage of the set current.
 - 10%- leakage current ≥ 10% of set current
 - 20%- leakage current ≥20% of set current
 - 40%- leakage current ≥40% of set current
 - 60%- leakage current ≥ 60% of set current
 - 9 80% leakage current ≥80% of set current
- b) When the EKELR-30 detects absence of zero-phase current transformer (ZSCT) connection, it will blink the leakage indicators.

Sensitivity Adjustment

The EKELR-30 features 2 rotary selector switches for sensitivity ($I\triangle n$) setting:

- (i) 9-position sensitivity selector ⊕ offers setting range of 30mA,50mA, 75mA, 100mA, 125mA, 150mA,200mA, 250mA and 300mA.
- (ii) 3-position sensitivity multiplier selector@switch offers selection of 1x.10x and 100x.

Example 1: To set I△n = 100mA

Step 1: Set sensitivity selector = 100mAStep 2: Set sensitivity multiplier selector=1x $I\triangle n = 100mA x1 = 100mA$

Example 2: To set I△n =25A

Step 1: Set sensitivity selector = 250mAStep 2: Set sensitivity multiplier selector = 100x $1\triangle \text{n} = 250\text{mA} \times 100 = 25\text{A}$

Tripping Delay Time Adjustment

- The 9-position time delay selector @ provides additional delay for fault discrimination.
- Selectable delays are: Instantaneous (no delay), 50ms, 100ms, 250ms, 350ms, 500ms, 1s, 2s and 5s.

Push Button Operations

a) Reset Button (b)

- The reset button is for resetting the light indicator and the trip contact after an earth leakage tripped.
- To reset, press the reset button once.

b) Test Button(i)

 Press the test button to simulate an earth leakage trip condition.

www.etek-china.com

EKELR-30 Earth Leakage Relay User's Guide



Remote Control Input*

a) Remote Test Input

This digital input is similar to the TEST push-button. To remotely test the relay, make a connection between terminals 3 and 5 of the relay.

b) Remote Reset Input

This digital input is to remotely reset the relay when tripped. To reset the relay, make a connection between terminals 3 and 4 of the relay.

Output Contacts


a) Trip Contact

This is a latching type contact. It operates when tripped.


b) 50% Pre-fault Contact*

Operates when leakage current reaches 50% of the sensitivity setting.


Connection Diagrams



230V Wiring Diagram



Overall and Installation Dimension



Technical Data

Auxiliary Supply

Supply Voltage : 110 VAC +/- 10% or

230 VAC +/- 10%

Frequency : 50 Hz or 60 Hz

VA rating : Less than 3VA

Setting

Sensitivity setting : 30mA, 50mA,75mA, 100mA,

125mA, 150mA, 200mA, 250mA, 300mA,500mA, 750mA, 1A, 1.25A, 1.5A, 2A, 2.5A, 3A, 5A, 7.5A,10A, 12.5A, 15A,20A, 25A, 30A.

Time delay setting : Instantaneous,50ms,100ms,

250ms, 350ms, 500ms, 1s,

2s and 5s.

Inputs

Remote test / reset inputs: N.O. dry contacts*

Sensor : ZSCT

Outputs

Contacts (Trip / 50% pre-fault*)

Contact arrangement : Change over

Contact rating : 6A, 250 VAC ($\cos \varphi = 1$)

Contact material : Silver alloy
Operating time : 15ms max

Expected electrical life : 100000 operations at

rated current

Expected mechanical life: 5 million operations

Approval : CE

Indicators

Auxiliary supply : Green light indicator
Time delay : Red light indicator
Trip : Red light indicator

Leakage current : 5 red lights for leakage levels

Mechanical

Mounting method : Din rail mounted

Approximate weight : 0.3 kg

www.etek-china.com

^{*} Applicable to EKELR-30 model only